Autotrol Performa[™]Cv

Conditioner/Filter

Water Control System

Installation, Operation and Maintenance Manual

This sⁱ stem installed bⁱ :

Table of Contents

1.0 Performa Cv S ^f stem 1.1 Specifications 1.2 Installation 1.3 Placing Performa Cv Conditioner/Filter into Operation 1.4 Disinfection of Water Conditioners	.3 .5 .7
 2.0 Performa Cv 962 Control. 2.1 Introduction to the Performa CV Conditioner and Filter S¹ stems	.9 10
3.0 Performa Cv Filter Valve and Controls, 962F, 962FTC, 942F 1 3.1 Programming and Application 1 3.2 E planation of Parameter Values for the 962 Single and Parallel Tank Controls 2	18
4.0 Performa Cv Performance Charts and Graphs	27 28
5.0 Performa Cv Service and Troubleshooting 3 5.1 Historical Data 3 5.2 Preventative Maintenance 4 5.3 Removing the Valve Assemble 6 5.4 Removing the Control 3 5.5 Identification of Control Valving 3 5.6 Valve Disc Principle of Operation. 3 5.7 Performa Cv Conditioner Flo Diagrams 5.8 Performa Cv Filter Flo Diagrams 5.9 Troubleshooting 4	34 35 36 36 38 38 38 38 38
6.0 Performa Cv Parts	44 45

1.0 Performa Cv System

1.1 Specifications

1.1.1 Performa Cv Conditioner

Flow Rates (Valve Only)

Service @ 15 psi (1.03 bar)	. 25.0 gpm (5.7 m ³ /h)
Back ash (Conditioner) @ 25 psi (1.72 bar) drop	. 20.0 gpm (4.5 m ³ /h)
Service	. Cv = 6.5 (Kv = 5.58)
Back ash Conditioner	. Cv = 4.0 (Kv = 3.46)

Control Configurations

962 Microprocessor Demand System and 962 Electronic Timeclock

Back ash
Brine Electronicall ⁴ calculated
Slo rinse
Fast rinse
E ternal Brine Valve Required - Timed Fill

Valve Connections/Dimensions

Tank Thread	le
Inlet/Outlet	net e

1.1.2 Performa Cv Filter Specifications

Flow Rates (Valve Only)

Service @ 15 psi (1.03 bar) drop	25.0 gpm (5.7 m ³ /h)
Back ash (Filter) @ 25 psi (1.72 bar) drop	25.0 gpm (4.5 m ³ /h)
Service	Cv = 6.5 (Kv = 5.58)
Back ash Filter	Cv = 5.0 (Kv = 5.78)

Control Operation

942F Mechanical Clock Timer - 7 Day or 12 Day	
Back ash	es
Fi ed Fast Rinse	es
962F Microprocessor Demand	
Back ash	€S
Fast Rinse	€S
962 FTC Electronic Time Clock	
Back ash	
Fast Rinse	€S
nterval Regeneration	n

Valve Connections/Dimensions

Tank Thread	2-1/2 inches - 8, male
Inlet/Outlet	1-3/4 inches - 12 UNC-2A, male
Drain Line	3/4-inch NPT, male
Brine Line	3/8-inch NPT, male
Distributor Tube O.D.	1.050 inches (27 mm)
Distributor Tube Length1/2	1/2 inches (13 mm 13 mm) above top of tank

Operating/

Valve Bod ⁷	Glass-filled Plastic
Rubber Components	Compounded for cold ater
Weight (Valve ith Control)	4.5 lbs (2.0 kg)
Transformer Output	12VAC 400 mA (4.6 vA)
Transformer Input	
	100V 50/60 H
Operating Pressure	
	Canada: 20 to 100 psi (1.37 to 6.89 bar)
Water Temperature	34° to 100°F (1° to 38°C)

Options

Flow Meter 962 Control	1-inch Autotrol Turbine
Brass NPT or BSPT Pipe Adapter	1-inch male, 3/4-inch male
Plastic NPT or BSPT Pipe Adapter	1-inch male, 3/4-inch male
CPVC, Solvent Weld Tube Adapter	1-inch, 3/4-inch, 25-mm
Copper, S eat Tube Adapter	1-1/4-inch, 1-inch, 3/4-inch, 28-mm, 22-mm
B [/] pass Inlet/Outlet Fitting Kits:	
B ⁷ pass Valve, Model 1265 B ⁷ pass Inlet/Outlet Fitting Kits:	1-3/4 inches - 12 UNC - 2A male
Dinago Value, Madel 1965	1.0/4 inches 10 LINC 04 male

See Section 4.1 for specification dra ings.

1.2 Installation

All plumbing and electrical connections must conform to local codes.

Inspect unit carefull⁷ for carrier shortage or shipping damage.

Location Selection

- 1. The distance bet een the unit and a drain should be as short as possible.
- 2. If it is likel, that supplementar ater treatment equipment ill be required, make certain adequate additional space is available.
- 3. Since salt must be added periodicall, to the brine tank, the location should be easil, accessible.
- 4. Do not install an⁷ unit closer to a ater heater than a total run of 10 feet (3 m) of piping bet een the outlet of the conditioner and the inlet to the heater. Water heaters can sometimes overheat to the e tent the⁷ ill transmit heat back do n the cold pipe into the unit control valve.

Hot ater can severel damage the conditioner. A 10-foot (3-m) total pipe run, including bends, elbo s, etc., is a reasonable distance to help prevent this possibilit. A positive a to prevent hot ater flo ing from heat source to the conditioner, in the event of a negative pressure situation, is to install a check valve in the soft ater piping from the conditioner. If a check valve is installed, make certain the water heating unit is equipped with a properly rated temperature and pressure safety relief valve. Also, be certain that local codes are not violated.

- Do not locate unit here it or its connections (including the drain and overflo lines) ill ever be subjected to room temperatures under 34°F (1°C) or over 120°F (49°C).
- 6. Do not install unit near acid or acid fumes.
- 7. The use of resin cleaners in an unvented enclosure is not recommended.

Water Line Connection

The installation of a b⁷ pass valve s⁷ stem is recommended to provide for occasions hen the ater conditioner must be b⁷ passed for hard ater or for servicing.

The most common b⁷ pass s⁷ stems are the Autotrol Series 1265 b⁷ pass valve (Figure 1.1) and plumbed-in globe valves (Figure 1.2). Though both are similar in function, the Autotrol Series 1265 b⁷ pass offers simplicit⁷ and ease of operation. Not in Bypass

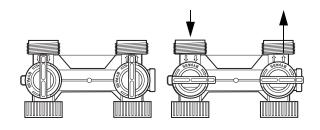


Figure 1.1 - Autotrol Series 1265 B⁷ pass Valve



Drain Line Connection

Note: Standard commercial practices are e pressed here. Local codes ma⁷ require changes to the follo ing suggestions.

- Ideall¹ located, the unit ill be above and not more than 20 feet (6.1 m) from the drain. For such installations, using an appropriate adapter fitting, connect 1/2-inch (1.3-cm) plastic tubing to the drain line connection of the control valve.
- If the back ash flo rate e ceeds 5 gpm (22.7 Lpm) or if the unit is located more than 20 feet (6.1 m) from drain, use 3/4-inch (1.9-cm) tubing for runs up to 40 feet (12.2 m). Also, purchase appropriate fitting to connect the 3/4-inch tubing to the 3/4-inch NPT drain connection.
- 3. If the unit is located here the drain line must be elevated, 'ou ma' elevate the line up to 6 feet (1.8 m) providing the run does not e ceed 15 feet (4.6 m) and ater pressure at conditioner is not less than 40 psi (2.76 bar). You ma' elevate an additional 2 feet (61 cm) for each additional 10 psi (0.69 bar).

- 4. Where the drain line is elevated but empties into a drain belo the level of the control valve, form a 7-inch (18-cm) loop at the far end of the line so that the bottom of the loop is level ith the drain line connection. This ill provide an adequate siphon trap.
- 5. Where the drain empties into an overhead se er line, a sink-t/ pe trap must be used.

IMPORTANT: Never insert drain line into a drain, se er line or trap. Al a's allo an air gap bet een the drain line and the aste ater to prevent the possibilit' of se age being back-siphoned into the conditioner.




Figure 1.3

Note: Standard commercial practices have been e pressed here. Local codes ma⁷ require changes to these suggestions.

Brine Line Connection

It ill be necessar' to install the brine line for a Performa Cv conditioner to the brine fitting on the valve (3/8-inch NPT).

Be sure all fittings and connections are tight.

Overflow Line Connection

In the absence of a safet⁷ overflo and in the event of a malfunction, the BRINE TANK OVERFLOW ill direct overflo to the drain instead of spilling on the floor here it could cause considerable damage. This fitting should be on the side of the cabinet or brine tank.

To connect overflo, locate hole on side of brine tank. Insert overflo fitting (not supplied) into tank and tighten ith plastic thumb nut and gasket as sho n (Figure 1.4). Attach length of 1/2-inch (1.3-cm) I.D. tubing (not supplied) to fitting and run to drain. Do not elevate overflo line higher than 3 inches (7.6 cm) belo bottom of overflo fitting. Do not tie into drain line of control unit. Overflo line must be a direct, separate line from overflo fitting to drain, se er or tub. Allo an air gap as per drain line instructions (Figure 1.3).

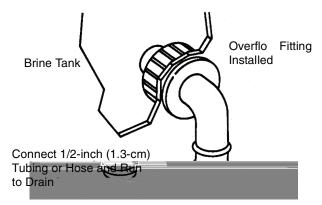


Figure 1.4

Battery Back-Up

All 962 famil⁷ controls are/batter⁷ backup capable. A 9-volt rechargeable batter⁷ is available from Osmonics, P/N 1075768. The batter⁷ is a VARTA, TYPE V7/8H (AccuPlus Nickle H⁷ dride Ni-mh 9v 150 mAH, No. 5522). A standard non-rechargeable batter⁷ is an option for backup but needs to be replaced periodicall⁷, Figure 1.5.

Figure 1.5

1.3 Placing Performa Cv Conditioner/Filter into Operation

After all previous steps have been completed, the unit is read to be placed into operation. Follo these steps carefull.

1. Remove control valve cover b⁷ first depressing the plastic clips from the front of the cover. Pull front of cover up.

Note: The follo ing steps ill require turning the c' cle indicator to various positions. Manually rotate the camshaft **COUNTERCLOCKWISE** only until c' cle indicator points to desired position. (See manual regeneration sections for each control's manual operation.)

- 2. Rotate c¹ cle indicator **COUNTERCLOCKWISE** until it points directl¹ to the ord **BACKWASH**.
- 3. Fill media tank ith , ater.
 - a. With ater suppl⁷ off, place the b⁷ pass valve(s) into the service position.
 - b. Open ater suppl' valve ver' slo l' to appro imatel' the 1/4 open position.

IMPORTANT: If opened too rapidl⁷ or too far, media ma⁷ be lost. In the 1/4 open position, ⁷ ou should hear air escaping slo I^{7} from the drain line.

Conditioner

- a. When all of the air has been purged from the tank (ater begins to flo steadil from the drain), open the main suppl valve all the a'.
- b. Allo ater to run to, drain until clear.
- c. Turn off ater suppl⁷ and let the unit stand for about five minutes. This ill allo all trapped air to escape from the tank.
- 4. Add ater to brine tank (initial fill).

With a bucket or hose, add appro imatel⁷ 4 gallons (15 liters) of ater to brine tank. If the tank has a salt platform above the bottom of the tank, add ater until the level is appro imatel⁷ 1 inch (25 mm) above the platform.

- 5. Place the conditioner into operation.
 - a. With the ater suppl⁷ valve completel⁷ open, carefull⁷ advance the c⁷ cle indicator **COUNTERCLOCKWISE** to the center of the **BRINE REFILL** position. Hold at this position until ater starts to flo through the brine line into the brine tank. Do not run for more than t o minutes.
 - Advance the cⁱ cle indicator
 COUNTERCLOCKWISE until it points to the center of the BRINE/SLOW RINSE position.

- c. With the conditioner in this position, check to see if ater is being dra n from the brine tank. The _ater level in the brine tank ill recede ver' slo l'. Observe ater level for at least three minutes. If the ater level does not recede, or if it goes up, reference the **Troubleshooting** section.
- d. Advance the cⁱ cle indicator
 COUNTERCLOCKWISE to the
 REGENERATION COMPLETE position and run ater from a nearbⁱ faucet until the ater is clear and soft.

Filter

All filter medias e cept carbon:

a. After the air has been purged from the tank (ater begins to flo /steadil from the drain) open the main suppl all the a . Back ash media for/a minimum of 15 minutes or longer if necessar . Water running to the drain should be clear.

Carbon media should be allo ed to soak for a minimum of 12 hours to allo air bubbles to escape prior to back ashing.

b. After the back ash is complete plug in control and allo it to advance to **BACKWASH COMPLETE**.

Electrical Connection

100 VAC, 115 VAC, and 230 VAC units: Remove t ist tie from the po er cord and e tend cord to its full length. Make sure po er source matches the rating printed on the control. Be certain a all s itch does not control the outlet.

12 VAC: Connect the plug of the transformer (supplied) secondar cable to the mating socket at the rear or bottom of the timer housing. Be certain the transformer is secure and is plugged into a po er source of correct voltage that is not controlled b a all s itch.

1.4 Disinfection of Water Conditioners

The materials of construction of the modern ater conditioner ill not support bacterial gro th, nor ill these materials contaminate a ater supply. Ho ever, the normal conditions e isting during shipping, storage and installation indicate the advisability of disinfecting a conditioner after installation, before the conditioner is used to treat potable _ ater. In addition, during normal use, a conditioner may become fouled ith organic matter or in some cases ith bacteria from the ater supply.

Thus ever⁷ conditioner should be disinfected after installation, some ill require periodic disinfection during their normal life, and in a fe cases disinfection ith ever⁷ regeneration ould be recommended.

Depending upon the conditions of use, the st^{7} le of conditioner, the t^{7} pe of ion e changer, and the disinfectant available, a choice can be made among the follo ing methods.

Sodium or Calcium Hypochlorite

Application

These materials are satisfactor for use ith pol'st rene resins, s' nthetic gel eolite, greensand and bentonites.

5.25% Sodium Hypochlorite

These solutions are available under trade names such as Cloro Bleach*. If stronger solutions are used, such as those sold for commercial laundries, adjust the dosage accordingl⁷.

- 1. Dosage
 - a. Polⁱ stⁱ rene resin: 1.2 fluid ounces per cubic foot.
 - b. Non-resinous e changers: 0.8 fluid ounce per cubic foot.
- 2. Brine tank conditioners
 - a. Back ash the conditioner and add the required amount of h⁷ pochlorite solution to the brine ell of the brine tank. (The brine tank should have ater in it to permit the solution to be carried into the conditioner.)
 - b. Proceed ith the normal regeneration.

Calcium Hypochlorite

Calcium h¹ pochlorite, 70% available chlorine, is available in several forms including tablets and granules. These solid materials ma¹ be used directh ithout dissolving before use.

- 1. Dosage
 - a. T o grains (appro imatel⁷ 0.1 ounce) per cubic foot.
- 2. Brine tank conditioners
 - a. Back ash the conditioner and add the required amount of h² pochlorite to the brine ell of the brine tank. (The brine tank should have ater in it to permit the chlorine solution to be carried into the conditioner.)
 - b. Proceed ith the normal regeneration.

*Cloro Bleach is a trademark of the Cloro Compan⁴.

2.2 Programming and Application

This section covers all aspects of programming the 962 control.

Note that some parameters have a single unit of measure option such as the Rinse Time hich is onl¹ entered in minutes. Other parameters have dual units such as Salt Amount hich can be entered in pounds or kilograms. To select hich units are active, look for a comment in the NOTES column of Table 2.1 and Table 2.4. It ill reference another parameter that selects

hich units are active. For e ample, Parameter P12 (Table 2.4) selects U.S. units if it is set to "**0**" and metric if it is set to "**1**."

Level I Parameters (Table 2.1)

Level I Parameters are identified as those that have an LED indicator on the front panel. The green indicator illuminates ne t to the name of the active control setting. The end user has access to all of these parameters. In general, pressing the **DOWN ARROW** (\downarrow) button display s the Level I Parameters in the follo ing order:

Time of Da⁷ Time of Regeneration Hardness Salt Ampunt Capacit⁷

If i^{2} ou continue to press the **DOWN ARROW** (\downarrow) button, the parameters start over ith Time of Da⁷. Pressing the **UP ARROW** (\uparrow) button displa⁷ s the parameters in reverse order. Refer to Table 2.1 for a description of these parameters and the available ranges for each parameter.

Press the **SET** button and the far right number on the displa' starts flashing. If i ou ant to change this number, press the **UP ARROW** (\uparrow) button to increase the number or the **DOWN ARROW** (\downarrow) button to decrease the number. To skip the number ithout changing, press the **LEFT ARROW** (\leftarrow) button. When i ou reach the far left digit, pressing the **LEFT ARROW** (\leftarrow) button ill return i ou to the far right digit.

Note: If $\frac{1}{2}$ ou press and hold either the **UP ARROW** (\uparrow) button or the **DOWN ARROW** (\downarrow) button for more than one second, the flashing number ill increment or decrement at the rate of 10 counts per second.

When the number is correct, press the **LEFT ARROW** (\leftarrow) button. The first number stops flashing and the net number starts flashing. You can onl' change the flashing number. Continue changing numbers until ' ou reach the desired setting. Press the **SET** button. The numbers stop flashing and the control accepts the ne setting. After appro imatel 30 seconds, the control starts alternating the displa' bet een Time of Da' and Capacit'.

Note: If a beep sounds, the ne setting is not accepted because it as outside the allo able range. The old value ill be displa⁷ ed.

Day of Week/Time of Day

Press the **SET** button. The displa⁷ ill sho the Time of Da⁷ ith the minutes digit blinking. If ⁷ ou ant to change this number, press the **UP ARROW** (↑) button to increase the number or the **DOWN ARROW** (↓) button to decrease the number. To skip the number ithout changing, press the **LEFT ARROW** (←) button.

Salt Amount

Salt Amount is the ne t value display ed. The default value for Salt Amount is 6 pounds (2.7 kilograms) of salt; refer to Table 2.2 for suggested salt settings.

Note: This is the total amount of salt used for a regeneration, not pounds per cubic foot. If 6 pounds is not acceptable, press the **SET** button and change the numbers. If 6 pounds is acceptable, press the **DOWN ARROW** (\downarrow) button.

Capacity

Capacit⁷ is the ne t value displa⁷ ed and is e pressed in kilograins (kilograms). Refer to Table 2.2 for the

P5 Capacity Resin Volume per Tank (liters) Setting						
Kilograins (Kilograms)	3 ft ³ (85)	4 ft ³ (113)	5 ft ³ (142)	6 ft ³ (170)	7 ft ³ (198)	
		P4 Salt Setting: Pounds (kg) of Salt				
60 (3.9)	18 (8.2)	-	-	-	-	
80 (5.2)	-	24 (10.9)	-	-	-	
84 (5.4)	30 (13.6)	-	-	-	-	
90 (5.8)	45 (20.4)	-	-	-	-	
100 (6.4)	-	-	30 (27.2)	-	-	
112 (7.2)	-	40 (18.1)	-	-	-	
120 (7.7)	-	60 (27.2)	-	36 (16.3)	-	
140 (9.0)	-	-	50 (22.7)	-	42 (19)	
150 (9.7)	-	-	75 (34)	-	-	
168 (10.8)	-	-	-	60 (27.2)	-	
180 (11.6)	-	-	-	90 (40.8)	-	
196 (12.7)	-	-	-	-	70 (31.8)	
210 (13.6)	-	-	-	-	105 (47.6)	
		P6 Refill Setting: 14 16 inch thru 21 inch				
P7 Brine Draw Se	etting. All values are		bar) inlet pressure. I in Section 4.0.	For pressure other tha	n 50 psi refer to brine	
Tank Diameter	Injector	Part Number	P7 equals	Color		
14 in (35.5 cm)	М	1055737	60	Bro n		
16 in (40.6 cm)	Q	1035739	80	Purple		
18 in (45.7 cm)	Q	1035739	80	Purple		
21 in (53.3 cm)	R	1035884	83	Jark Gre		

Table 2.2 - Suggested Settings for P4, P5, P6, P7

Level II Parameters (Table 2.4)

The Level II Parameters are P6 through P22 in Table 2.4. To access Level II Parameters, simultaneousl' press and hold the **DOWN ARROW** (\downarrow) and **UP ARROW** (\uparrow) buttons for three seconds. A P number ill displa'.

Refer to Table 2.4 to find the parameter associated ith each P number. Use the **UP ARROW** (\uparrow) button or the **DOWN ARROW** (\downarrow) button to move from one parameter to the net. The displated circles through the P numbers shon in Table 2.1 and Table 2.4. When i ou reach P22, the net P number ill go back to P1.

When the parameter number i ou ant to change is on the displa', press the **LEFT ARROW** (\leftarrow) button to displa' the data assigned to that parameter. Press the **SET** button and the far right number on the displa' starts flashing. If i ou ant to change this number, press the **UP ARROW** (\uparrow) button or the **DOWN ARROW** (\downarrow) button. To skip the number ithout changing, press the **LEFT ARROW** (\leftarrow) button. When the number is correct, press the **SET** button. The numbers stop flashing and the control accepts the ne setting. If a beep sounds, the ne setting as not accepted. Refer to Table 2.4 for allo able values for that parameter.

To change or vie other parameters, press the **LEFT ARROW** (\leftarrow) button to have the displar sho P numbers. No use the **UP ARROW** (\uparrow) button or the do n arro (\downarrow) button to move to the parameter number ou ish to change.

To e it the Level II programming mode, simultaneously press and hold the **DOWN ARROW** (\downarrow) and **UP ARROW** (\uparrow) buttons for three seconds, or ait 30 seconds ithout pressing a button. The control starts alternating the display bet een Tank in Service, Flo Rate and Capacity.

Settings for all parameters can be ritten on the label provided ith the control. The label has an adhesive backing so it can be attached to the inside rear cover of this manual for future service reference.

Level II Programming

Parameter P6 is used b⁷ the control to calculate the Refill Time. Press **SET** button and enter a ne value. Refer to Table 2.2 for the correct value. Parameter P7 is used b⁷ the control to calculate the brine dra time. Press the **SET** button and enter a ne value. Refer to Table 2.2 for the correct value. The control calculates the brine dra time using this value and the salt amount. The brine dra time is added to the Rinse Time (P10) to determine the total Brine Dra /Slo Rinse Time.

This control does not use Parameter P8. No entr⁷ is needed for this parameter.

Parameter P12 selects the units of measure. Be sure that this is set to the correct value before entering an data for Parameters P3, P4 or P5.

Parameter P13 selects the clock displa⁷ mode. If the 12-hour mode is selected, a PM indicator is used. If the 24-hour mode is selected, the PM indicator is not used.

Parameter P15 has four allo able values. Values 0 or 1 ill cause the control to ait for Parameter P2, time of da⁷ of regeneration, to begin the regeneration. Values 2 or 3 ill cause the control to start the regeneration as soon as the capacit⁷ is e hausted.

When Parameter P15 selects a smart reserve t⁷ pe, 0 or 2, Parameter P16 is used to calculate the initial seven average dail⁷ ater usage values. The control multiplies the total capacit⁷ b⁷ the percentage entered for Parameter P16 and uses that value as the initial average dail⁷ usage for each da⁷ of the eek until ater usage establishes ne averages, refer to Reserve Options, page 15.

Parameter 17 must be programmed follo ing the appropriate programming table. Improper , regenerations ill occur if P17 is set to an' other number.

Parameter P18 allo s the installer to lock the Salt Amount and Capacit' values so the' cannot be changed. When Parameter 18 is set to 1, those t o settings can onl' be vie ed hen the control is in the Level II mode. The settings ill be skipped hen the control is in the Level I mode. When Parameter 18 is set to ero, the Salt Amount and Capacit' can be vie ed and changed in either Level I or Level II.

Parameter P19/selects the flo sensor that is to be used ith the s⁷ stem. The factor⁷ preset value is 1 for a 1-inch turbine. The range is 1 - 4. 1 = Autotrol 1-inch turbine, 2 = Autotrol 2-inch turbine, 3 = user programmable K-factor, 4 = user programmable pulse equivalent. The K-factors or pulse equivalents for individual meters should be supplied b⁷ the respective meter manufacturer.

Parameter P20 is programmed only if P19 = 3 or 4. P20 is here the factor supplied K-factor or pulse equivalent number is programmed.

Parameter P21 allo s the user to tell the control ho long a signal must be present at the remote d1(m)9.3(-6.3(t)s6.5(h)0.4.4(at)8 10.8 3e)-23.(t)s6.5((m)9.e4.4 Parameter P22. Special codes are entered at the factor to program all of the pertinent P locations for specific controls; Metric for e ample. This parameter should never be changed by the end user.

Electronic Time Clock Operation

Programming automatic regeneration frequenc⁷:

The Electronic Time Clock has t o regeneration options: Interval Regeneration and Da⁷ of Week Regeneration.

To initiate an automatic regeneration one or both of the options must be chosen. The s' stem ma' also be regenerated manuall' b' pressing the Regeneration button for three seconds.

Interval Regeneration The Electronic Time Clock mail be programmed to regenerate in intervals of up to 30 dails. This feature is Parameter P14 Calendar Override (see Table 2.4). E ample: If 5 is programmed into P14 then the silstem ill regenerate every five dails at the time programmed into P2.

Day of Week Regeneration The Electronic Time Clock ma⁷ be programmed to regenerate on a specific da⁷ or on specific da⁷ s of the eek. The instructions for this option are found in Table 2.3 on page 15.

Application

The Performa Cv 962 Conditioner and the Performa Cv 962F Filter ma⁷ be operated as a single, dual, or triple s⁷ stem.

Dual and Triplex Conditioners and Filters

The dual and triple s^{7} stems require a different cam than/the cam that is used in the single unit s^{i} stems. The^{*i*} also require an interconnecting lock out cable. This allo s the unit that is in regeneration or back ash to signal the other units and prevents them from starting a regeneration or back ash until the first unit is finished. Dual and triple units should be plumbed in parallel ith each other, In a multi-unit sⁱ stem the back, ash ater is supplied b', the other unit or units in the s' stem. In a dual filter sⁱ stem consideration must be given that the unit in service is able to satisf' service requirements and be able to suppl' sufficient back ash ater to the other filter hile it is in the back ash cⁱ cle. There is a selection guide, Table 4.6, in Section 4.0 to assist in qualif^{*i*} ing the choice of a dual or triple s^{*i*} stem. This selection guide is based on media back ash requirements and tank diameter.

A parallel kit must be purchased for multi-unit operation. The kit numbers are:

Dual Parallel Conditioner	P/N 1035923
Triple Parallel Conditioner	P/N 1035925
Dual Parallel Filter	P/N 1035924
Triple Parallel Filter	P/N 1035926

Kits include parallel operation cams and the proper interconnect cable.

Manual Start Regeneration

To force the control to perform a regeneration, press the **REGEN** button. This button is located on the front of the control. When *i* ou press the **REGEN** button, the control performs a full regeneration of the conditioner.

If you press this button again more than one minute after regeneration begins, but before the regeneration is complete, a second regeneration will start when the first regeneration is finished. The displa^{*i*} ill free e and onl^{*i*} sho the Regen Time Remaining as an indication that the second regeneration ill be performed. When the first regeneration is complete, the second one ill begin and the displa^{*i*} ill alternate bet een Flo and Regen Time Remaining.

Automatic Regeneration

Programming Day of the Week Regeneration/ Backwash

Enter Da⁷ of the Week Regeneration/back ash programming b⁷ depressing the **LEFT ARROW** (←) button and the **DOWN ARROW** (↓) button simultaneousl⁷ for 3 seconds, The da⁷ s are sho n as d1, d2, d3, etc., on the displa⁷. Select the da⁷ s of the eek regeneration/back ash should occur. To activate that da⁷, change the Ø to a 1. The programming mode

ill be e ited if no ke's are pressed for 30 seconds. If this feature is used in conjunction ith calendar override the calender override timer ill be reset at the end of this regeneration/back ash.

#	Description of Parameter	Set as required 0 = No - 1 = yes	Notes	
d1	Sunda	As required	$0 = no da^{\dagger}$ of eek regeneration 1 = back ash this da^{\dagger}	
d2	Monda	As required	0 = no da' of eek regeneration $1 = back$ ash this da'	
d3	Tuesda	As required	0 = no da' of eek regeneration $1 = back$ ash this da'	
d4	Wednesda	As required	$0 = no da^{\dagger}$ of eek regeneration $1 = back$ ash this da^{\dagger}	
d5	Thursda	As required	$0 = no da^{\prime}$ of eek regeneration $1 = back$ ash this da^{\prime}	
d6	Frida	As required	$0 = no da^{1}$ of eek regeneration $1 = back$ ash this da ¹	
d7	Saturda	As required	0 = no da' of eek regeneration $1 = back$ ash this da'	

Table 2.3 - Day of Week Regeneration/Backwash

Reserve Options

There are t o t^{7} pes of reserve options for this control: fi ed reserve and smart reserve (historical ater usage pattern). The are selected ith Parameter P15.

Fixed Reserve

When fi ed reserve is selected, the control multiplies the ma imum sⁱ stem capacitⁱ bⁱ the percent value set in Parameter P16 and uses the result as a reserve.

Smart Reserve (water usage pattern)

The other reserve option allo s the control to adjust the reserve based upon the historical ater usage pattern of the s' stem. The control keeps track of the ater usage for each da' of the yeek and uses that da' 's average usage multiplied b' 1.2 as the reserve for that da'. Ever da' at the Time of Regeneration, the control recalculates the da' 's average ater usage. If less than 10% of a da' 's average ater usage is used, the control

ill not change the da' 's average. If more than t ice the da' 's average is used, the control uses the actual usage in the reserve calculation.

Since a ne installation has no histor⁷ of ₁ ater usage, the control multiplies the percent of capacit⁷, value set in Parameter P16 b⁷ the total s⁷ stem capacit⁷ to determine starting average for each da⁷ of the eek. The factor set value for P16 is 30 hich means that 30% of the total s stem capacit is used for the starting average for each da.

Program Parameter P15 is also used to select hether the control aits until the Time of Regeneration set in Parameter P2 to start a regeneration, or if the control should begin a regeneration immediatel hen the capacit remaining is less than the reserve.

2.3 Conditioner Programming Tables

Table 2.4 - Level II Programming Performa Cv 962 Parallel Multi Tank or Single Tank Conditioner

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P6	Refill controller	2-200	1	Selected from Table 2.2		This number tells the controller the rate of refill based on the refill control installed. Refill d ell time is calculated to refill the proper amount of ater into brine tank.
P7	Brine dra rate	2-200	1	Selected from Table 2.2		This number tells the controller the dra rate based on the injector si e. The d ell time in the dra position is then calculated.
P9	Back ash time	4-60	1	14*	Minutes	*Ma be adjusted for application

Minutes *Ma⁷ be adjusted for application

ri t(e23--30.9ho5(t(eu(s)3461(cl3TJ 1.4c)34.2(k,)Tc636.9

Go to Section 3.2 for detailed e planation of the programming parameters on this page.

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P1	Da ⁷ of Week and Time of Da ⁷	(1-7) 1:00-12:59 AM or PM Metric (1-7) 0:00-23:59	(1 da⁄) 1 Minute	Current Day and Time	Hour Minute	Range depends on value selected for P13. For da ⁷ of eek SUN=1, MON=2, TUE=3, WED=4, THU=5, FRI=6, SAT=7,. THIS IS THE LEFT MOST DIGIT ON THE DISPLAY
P2	Time of da to start regeneration	1:00-12:59 AM or PM 00:00-23:59		As required	Hour Minute	Range depends on value selected for P13
P3	As recommended			10		
P4	Salt amount	.5-125.0 .2-50.0	.5 .2	Selected from Table 2.2	Pounds Kilograms	
P5	Program as Recommended			10		
P6	Refill controller	2-200	1	Selected from Table 2.2		This number tells the controller the rate of refill based on the refill control installed. Refill d ell time is calculated to refill the proper amount of ater into brine tank.
P7	Brine dra rate	2-200	1	Selected from Table 2.2		This number tells the controller the dra rate based on the injector si e. The s ell time in the dra posițion is then calculated.
P9	Back ash time	4-60	1	14*	Minutes	*May be adjusted for application
P10	Slo Rinse time	7-125	1	40*	Minutes	*Ma ⁱ be adjusted for application. This time does not include the calculated brine dra time.
P11	Fast Rinse time	2-60	1	4*	Minutes	*Ma ⁷ be adjusted for application
P12	Units of measure	0-1	1	0		0 = US, 1 = Metric
P13	Clock mode	0-1	1	0	1	0 = 12 hour clock, $1 = 24$ hour clock
P14	Interval Regeneration Calendar override	0-30	1	0	Da ⁱ s bet een regeneration	0 = no interval chosen - *Ma ⁷ be adjusted for application.
P15	Does not appl ⁷ for Timeclock operation			0		
P16	Does not appl ⁷ for Timeclock operation			30		
P17	Operation t ² pe	3-4	1	6		6 = Single 962TC
P18	Salt Change Lock out	0-1	1	0		0 = none, 1 = Salt/Capacit change locked out
P19	Does not applif for Timeclock operation					
P20	Does not appl ⁷ for Timeclock operation					
P21	Remote Regeneration S itch Dela [/]	0-254	1	60	Seconds	Time remote s itch must be active to start a regeneration
P22	Factor [/] Use Onl [/] - <u>DO NOT CHANGE</u>			99		

Go to Section 3.2 for detailed e planation of the programming parameters on this page.

Table 3.2 - Programming Performa Cv 962F Five Cycle Filter

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of
-----------	-------------	--------------------	----------------------	---------------------------------	----------

Go to Section 2.2 for detailed e planation of the programming parameters on this page.

Table 3.3 - Programming Performa Cv 962 TC Electronic Time Clock Filter

Parameter	Description	Range of Values	Minimum Increment	Recommended Program Value	Units of Measure	Notes
P1	Da ⁷ of eek and time of da ⁷	(1-7) 1:00-12:59 AM or PM Metric (1-7) 0:00-23:59	(1 da [/]) 1 Minute	Current Day and Time	Hour Minute	Range _/ depends on value selected for P13. For da [/] of eek SUN=1, MON=2, TUE=3,

Go to Section 2.2 for detailed e planation of the programming parameters on this page.

Electronic Time Clock Operation

To initiate an automatic back ash one or both of the follo ing options must be chosen. The s' stem ma' be back ashed manuall' b' pressing the Back ash button for three seconds.

Programming automatic regeneration frequenc⁷:

The Electronic Time Clock has t o regeneration options: Interval Regeneration and Da⁷ of Week Back ash.

Interval Backwash The Electronic Time Clock ma⁷ be programmed to regenerate at intervals up to 30 da⁷ s. This feature is also kno n as Calendar Override. It is located at P14. E ample: If 5 is programmed into P14 then the s⁷ stem ill back ash even five da⁷ s at the time programmed into P2.

Day of Week Backwash The Electronic Time Clock mail be programmed to back ash on a specific dail or specific dail s of the eek. The instruction for this option is found in Table 2.3 on page 17.

Application

The Performa Cv 962 Conditioner and the Performa Cv 962F Filter ma⁷ be operated as a single, dual, or triple s⁷ stem.


Dual and Triplex Conditioners and Filters

The dual and triple s' stems require a different cam than the cam that is used in the single unit s' stems. The' also require an interconnecting lock out cable. This allo s the unit that is in regeneration or back ash to signal the other units and prevents them from starting a regeneration or back ash until the first unit is finished. Dual and triple units should be plumbed in parallel ith each other In a multi-unit s' stem the back ash ater is supplied b' the other unit or units in the s' stem. In a tst TD0.memse-16.9(t)1sfh t TD0.r ihan tgnalr (han t)'.4(c)-(han t)ird

3.2 Mechanical

Series 942F Mechanical Control

The Series 942F mechanical control provides mechanical timeclock function for filter applications.

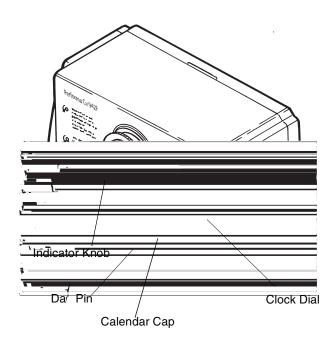



3.2.1 Settings

Setting the Time of Da⁷, the Da⁷ s of Back ash and performing manual back ashing ith the 942F controls.

Setting the Time of Day

Rotate the Clock Dial **clockwise** until the pointer indicates the correct time of da⁷. With the time of da⁷ set, the conditioner ill back ash at appro imatel⁷ 2:00 a.m. If it is desired to have the unit back ash at an earlier or later time, simpl⁷ offset the current time of da⁷ accordingl⁷. For e ample, to have the unit back ash at 4:00 a.m., set the Clock Dial 2 hours later than the actual current time of da⁷.

Note: Do not rotate the Calendar Cap by hand. The Clock Dial inde es the Calendar Cap dail'. To manuall' inde the Calendar Cap, rotate the Clock Dial **clockwise** one complete turn for ever' da' to be inde ed. Da' pins should be in the out ard position during Clock Dial rotation to prevent an undesired back ash. Reset da' pins hen completed.

Setting the Days of Backwash

Setting the da¹ s that the conditioner ill back ash is accomplished in t o simple steps:

- 1. Pull all of the da¹ pins out ard.
- 2. Push in the da⁷ pin(s) for the da⁷ (s) on hich a back ash is desired.

NOTE: The NEXT DAY pin is noted on the control face. Pushing this pin ill insure a back ash the ne t da' at appro imatel⁷ 2:00 a.m. since the Calendar Cap <u>j</u> progresses in a clock ise direction, pushing the da' pin immediatel⁷ follo ing the NEXT DAY pin counterclock ise ill insure a back ash occurs the follo ing da' at appro imatel⁷ 2:00 a.m. This progression is noted on the control face as FUTURE DAYS.

Manual Backwash

E gessive ater usage or other service related issues mail create the need to manuall' back ash the filter. This function is performed b' rotating the Indicator Knob **COUNTERCLOCKWISE** to the START position. Once in this position, the filter ill begin a back ash ithin a fe minutes. The normal schedule, established ith the pushed in da' pins, ill not be disrupted b' a manual back ash.

24 Hour Clock

The Performa Cv Series 942F control utili es a 24 hour clock dial. This is t² picall² referred to as Militar⁷ Time . The hours of the da⁷ bet een 12:00 a.m. (midnight) and 12:00 p.m. (noon) are designated on the clock dial b⁷ the numbers 1 through 12, ith 1 being 1:00 a.m. The hours of the da⁷ bet een 12:00 p.m. (noon) and 1/2:00 a.m. (midnight) are designated on the clock dial b⁷ the numbers 13 through 24, ith 13 being 1:00 p.m. Be sure to set the correct time of da⁷ accordingl⁷.

Adjusting the Backwash Setting

The Back ash Dial (Figure 3.2) controls the back ash time. With the Indicator Knob in the BACKWASH COMPLETE position, rotate the Back ash Dial counterclock ise at least one full turn to cancel out the current setting. A light clicking sound ill be replaced b' a heavier clicking sound hen the previous setting is cancelled. Once the heavier clicking is heard, the ne setting ma' be set b' rotating the Back ash Dial to the desired setting. The numbers on the Back ash Dial represent MINUTES of back ash time.

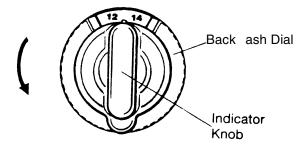


Figure 3.2 Back ash Complete

 Table 3.4 - Cycle Times for 942F Control

Cycle	Time (Minutes)
Back ash	8 - 30
Purge	9

3.3 Explanation of Parameter Values for the 962 Single and Parallel Tank Controls

This section contains a detailed e planation of the programming parameters in the 962 electronic control.

Number	Description of Program Values	Explanation
P1 *	Time of Da [/] Trn	

Number	Description of Program Values	Explanation
P5 page 12	Capacit ⁷ of unit	Enter the capacit ⁷ of the unit here, in kilograins (kilograms). For e ample, a 3 ft ³ unit ith a resin capacit ⁷ of 25,000 grains (1620 grams) per ft ³ , enter 75 here. (25,000 grains/ ft ³) (3 ft ³) = 75,000 grains = 75 kilograins. [(1620 grams/ ft ³) (3 ft ³) = 4860 grams = 4.86 kilograms]. Note: 15 lb/cu ft salting ⁷ ields 30,000 grains/cu ft resin 10 lb/cu ft salting ⁷ ields 25,000 grains/cu ft resin 6 lb/cu ft salting ⁷ ields 20,000 grains/cu ft, resin Reduced salting ⁷ ields a reduced capacit ⁷ 1 kilograin (1000 grains) = 0.0648 kilograms (64.8 grams)
P6 page 12	Refill control	Enter value from Table 2.1 - Suggested Settings on page 12 of manual. This value is the refill flo rate times 100, rounded to the net hole number. For e ample, on a 16-inch tank, the refill control has a flo rate of 1.3 gpm. Enter 130 (1.3 gpm $100 = 130$).
P7 page 12	Brine dra rate	Enter value from Table 2.1 - Suggested Settings on page 12 of manual. This is the injector dra rate times 100, rounded to the net hole number. For e ample, on a 16-inch tank, the injector has a dra rate of 0.8 gpm. Enter 80 (0.8 gpm $100 = 80$).
P8	Not used	P8 is reserved for future use.
P9	Back ash time	Self e planator. Generall, 5 to 15 minutes or until ater runs clear or specific ater conservation needs are met.
P10	Slo rinse	Time, in minutes, to achieve adequate slo rinse volume for resin t^2 pe used. Resin manufacturers recommend one to t o and one half bed volumes of slo rinse ater. The required amount of time is calculated using the injector performance curves provided in Section 4.0 of this manual.
		For e ample, assuming 4 cubic feet of resin and t o bed volumes of slo rinse ater for a 16 65, 50 psi inlet pressure, program 43 minutes in Parameter P10. (4 cubic feet) (7.5 gallons/cubic foot) 2 (bed volumes) = 60 gallons of slo rinse ater. A Q injector is recommended for a 16-inch tank. From the Q injector performance chart the nominal slo rinse rate is 1.4 gpm. 60 gallons divided b^{i} 1.4 gallons per minute equals 42.8 minutes. Round up to 43 minutes and enter in P10.
P11	Fast rinse	Time, in minutes, to achieve adequate fast rinse volume for resin t' pe used. For e ample, for standard softening resin (lonac C-249), fast rinse at 30 gallons (0.11 m ³) per cubic foot of resin. A unit ith 3 ft ³ of resin ill require 90 gallons (0.34 m ³) of ater to obtain the resin manufacturer's recommended fast rinse. (30 gal/ ft ³ 3 ft ³) = 90 gallons. (0.11 m ³ / ft ³ 3 ft ³ = 0.34 m ³). The fast rinse flo rate is controlled b ⁷ the drain line flo control. For this e ample, assume a 5 gpm (1.14 m ³ /hr) drain line flo control. Enter 18 minutes in P10. (90 gallons/5 gpm) = 18 minutes (0.34 m ³ /1.14 m ³ /hr = 0.3 hr/ 60 min = 18 minutes).
P12	Units of measure	Self e planator, Enter 0 for U.S., enter 1 for metric.
P13	Clock mode	Self e planator. Enter 0 for 12-hour clock, enter 1 for 24-hour clock.
P14	Calendar override	0 = No calendar override. 1 - 30 = Ma imum number of da s bet een regeneration/back ash.
P15	Reserve t ⁷ pe Immediate or dela ⁷ regeneration	See P2. Not used in Alternating mode.
P16 ***	Fi ed Reserve capacit	If P15 is set at 1 or 3, enter the fi ed reserve capacit (in gallons) (m ³) that the unit ill look for as e plained in sections P2 and P15 above. Not used in Alternating mode.
P17	Operation t ⁷ pe	Self e planator . 3 = Single or parallel Conditioner or Tank; 4 = Single or Parallel Filter.


Number	Description of Program Values	Explanation
P18	Salt/capacit	Allo s for the lock out of P4 and P5 so that NO unauthori ed changes to the programmed values can be made.
P19	Flo Sensor Select	This parameter is used to select the flosensor that is to be used ith the sistem. The factor '-preset value is 1 for a 1-inch turbine. The range is 1 - 4. 1 = Autotrol 1-inch turbine, 2 = Autotrol 2-inch turbine, 3 = user programmable K-factor, 4 = user programmable pulse equivalent. The respective meter manufacturer should supply the K-factors or pulse equivalents for individual meters.
P20	K-factor or pulse equivalent	The range is 000.01 to 255.00 in 0.01 steps. Ho this number is used is defined b' the values stored in P12 (units of measure) and P19 (flo sensor select). P12 is used to define gallons or liters (0 = gallons, 1 = liters). P19 is used to define K-factor or pulse equivalent (3 = K-factor, 4 = pulse equivalent). K-factor is defined as pulses per gallon or pulses per liter. Signet and Sea-Flo are t o flo sensor manufacturers that publish a K-factor. The control can no use an' flo sensor as long as the programmed K-factor is correct. The pulse equivalent is defined as gallons or liters per pulse. The control ill register 5 gallons of flo for ever' pulse if P12 = 0, P19 = 4 and P20 = 5.00. Badger Meter is one manufacturer that uses a pulse equivalent. The control ill not sho flo rate if P19 = 4 (pulse equivalent). This is because pulses are accumulated over 10 seconds and flo rate is display ed in gallons per minute. The control ill alternate bet een time of da' and capacit' remaining or regeneration time remaining during normal operation.
P21	Remote regeneration/ back ash s itch dela	This parameter is used to program the length of signal time required to initiate a regeneration/back ash using a differential pressure s itch or remote start button/contact. The range is 1 to 254 seconds in 1-second steps. The default is 60 seconds. A counter starts hen there is a closed dr' contact (no voltage) to this input. A regeneration/back ash ill start hen the contacts remain closed for the programmed time. The counter ill reset to ero hen the contacts open for at least 0.02 seconds. The remote regeneration input cannot be used to perform a double manual regeneration. The remote regeneration input is ignored during a regeneration/back ash.
P22	Factor, use only	DO NOT CHANGE

* The 962 controller functions in either a 12-hour or 24-hour clock mode. Programming P13 (clock mode) before P1 or P2 ill eliminate and confusion hen setting these parameters.


** The 962 controller functions in either U.S. or metric units. Programming P12 (units of measure) before P3 or P4 ill eliminate an⁷ confusion hen setting these parameters. *** The calculated gallon amount loaded into the dail' registers (L7 through \downarrow 13) at START-UP, uses this percentage of capacit'. E ample: 90,000 grains in P5 10 grains in P3, 90,000 / 10 = 9,000 gallon capacit', 9,000 .3 (30% in P16) = 2700 gallons, hich is loaded into L7 through L13, the dail' averages. For this e ample, the smart reserve at START-UP, ould be 2700 gallon 1.2 (120% of the dail' average) = 3240 gallon. This dail' average ill change as actual ater usage information is gathered.

4.0 Performa Cv Performance Charts and Graphs


4.1 General Specification

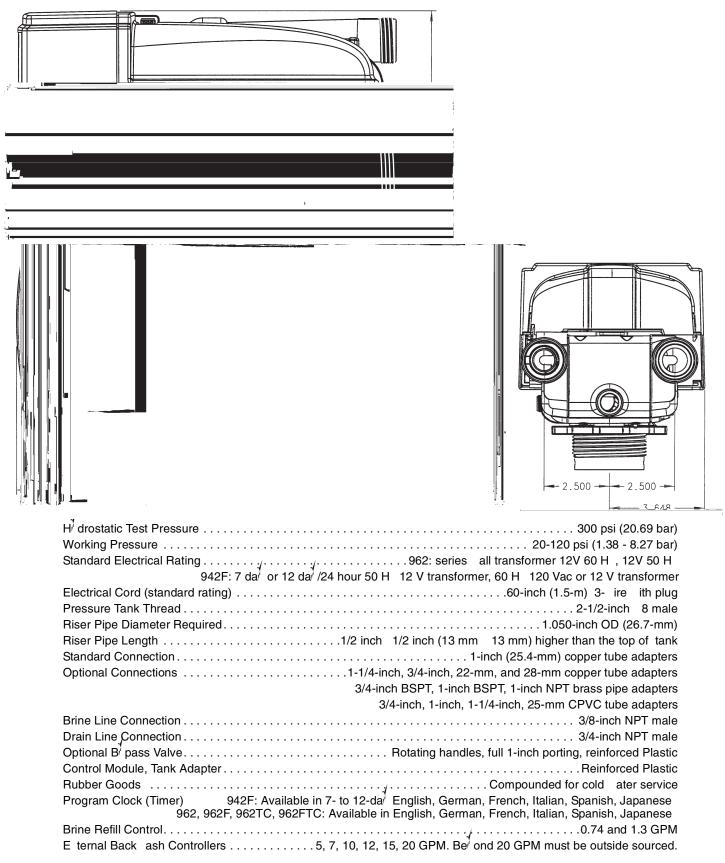



4.2 Injector Curves

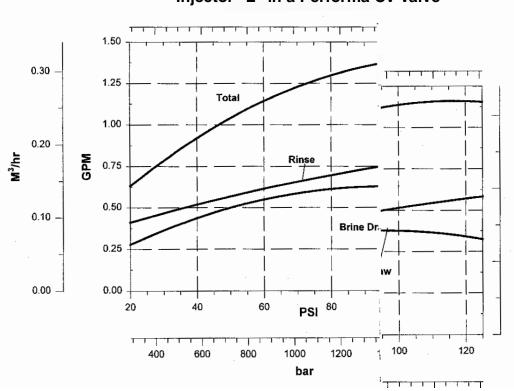

Injector "L" in a Performa Cv Valve

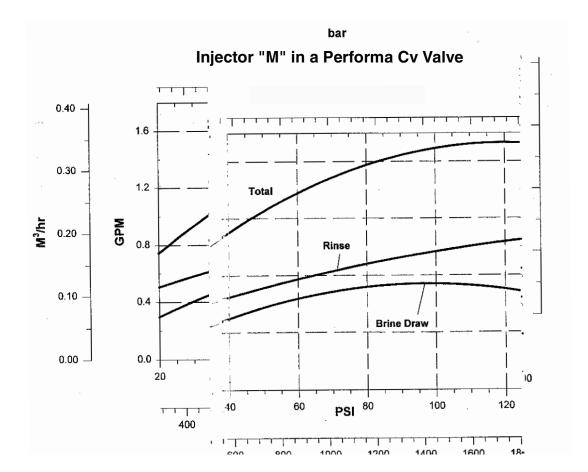

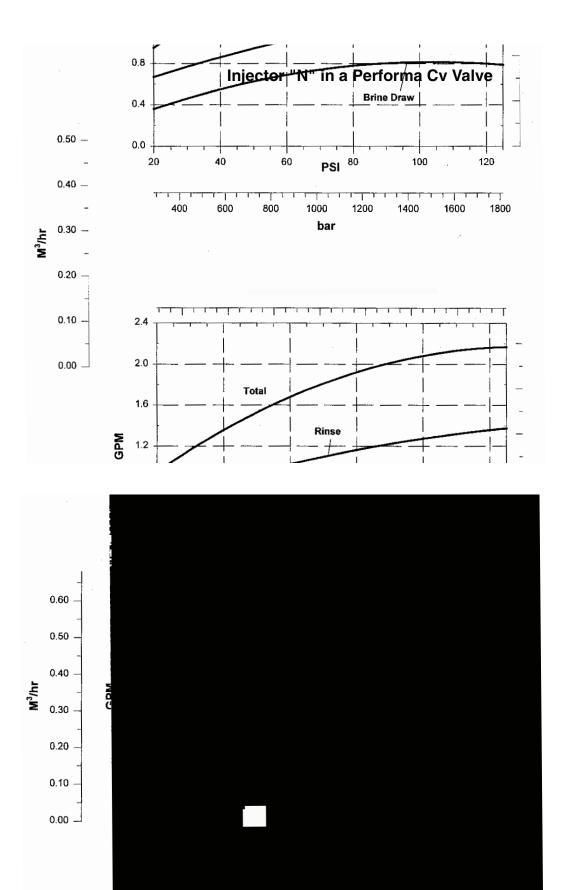

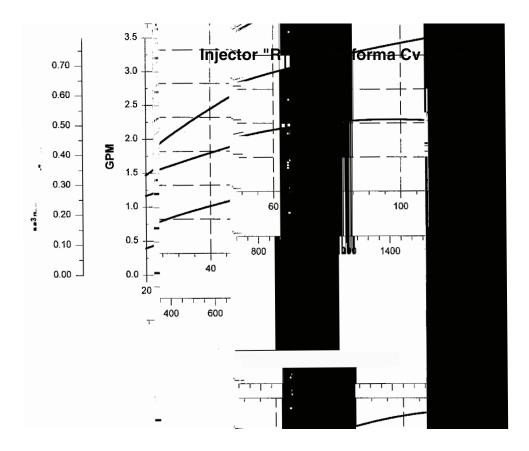

4.3 Performa Cv Conditioner Performance Data

			Inject	ors L - R F	low Rate C	Charts (gpn	n)			
PSI	I	L	М		N		Q		R	
	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse
20	0.26	0.4	0.3	0.5	0.4	0.65	0.4	0.9	0.45	1.2
30	0.3	0.45	0.4	0.55	0.45	0.75	0.5	0.95	0.5	1.3
60	0.5	0.6	0.6	0.8	0.75	1	0.82	1.4	0.9	1.75
80	0.6	0.65	0.7	0.85	0.8	1.1	0.9	1.6	1	2
100	0.6	0.76	0.7	0.9	0.8	1.6	0.95	1.8	1.1	2.2
	·		Inject	ors L - R F	low Rate C	harts (Lpn	n)			
Bar		L	I	N		N		Q		R
	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse	Draw	Rinse
1.4	0.98	1.5	1.1	1.9	1.5	2.5	1.5	3.4	1.7	4.5
2.1	1.1	1.7	1.5	2.1	1.7	2.8	1.9	3.6	1.9	4.9
4.2	1.9	2.3	2.3	6	2.8	3.8	3.1	5.3	3.4	6.6
5.6	2.3	2.5	2.6	3.2	3	4.2	3.4	6	3.8	7.6
7	2.3	2.9	2.6	3.4	3	4.9	3.6	6.8	4.2	8.3

Table 4.1 - Performa Cv Injector Performance Chart

Table 4.2 - Service and Backwash Flow Performance Data

	Flow vs Pressure Drop	o (gpm)	Flow vs Pressure Drop (Lpm)			
PSI	Service (Cv 6.5)	Backwash (Cv 4.0)	Bar	Service (Cv 6.5)	Backwash Cv 4.0)	
5	15	9	0.35	56	34	
10	20	13	0.7	76	49	
15	25	16	1	95	61	
20	29	18	1.4	109	68	
25	32	20	1.7	121	76	
30	35	22	2.1	132	83	

Table 4.3 - Recommended Drain Flow Controls (Backwash Anion and Cation Resin @ 55°F (12.7°C) Water Temperature

Tank Diameter Inches (mm)	Bed Area sq. ft.	Anion Resin @ 3 gpm/sq ft (m ³ h/sq ft)	Cation Resin @ 5 gpm/ sq ft (m ³ h/sq ft)
14 (35.6)	1.02	3 (.7)	5 (1.1)
16 (40.6)	1.38	4 (.9)	7 (1.5)
18 (45.7)	1.76	5 (1.1)	8 (1.8)
21 (53.3)	2.4	7 (1.5)	12 (2.7)

Pressure Loss vs Flow (gpm)					
PSI	Service (Cv 6.5)	Backwash (Cv 5.0)			
5	15				
10	20	16			
15	25	19			
20	29	22			
25	32	25			
30	35	27			
	Pressure Loss vs Flow (Lp	m)			
Bar	Service (Kv 5.6)	Backwash (Kv 5.8)			
0.35	56	42			
0.7	76	61			
1	95	72			
1.4	109	83			
1.7	121	95			
2.1	132	102			

Table 4.4 - Performa Filter

Table 4.5 - Typical Backwash Flow Requirements for Various Filter Medias (based on 55°F (12.7°C) water temperature)

		GAC/CARBON FILT	TER-AG, CALCITE		
			GREENSAND		
		BIRM			
		8 gpm/sq ft (Lpm/sq ft)	10 gpm/sq ft (Lpm/sq ft)	SAND, MULTI-MEDIA	
Tank Dia. inches (mm)				12 gpm/sq ft (Lpm/sq ft)	15 gpm/sq ft (Lpm/sq ft)
14 (35.6)	1.02	8 (30)	10 (38)	12 (45)	15 (57)
16 (40.6)	1.38	11 (42)	13 (49)	16 (61)	20 (76)
18 (45.7)	1.76	14 (53)	17 (64)	21 (79)	*26 (98)
21 (53.3)	2.4	19 (72)	24 (91)	*29 (98)	
24 (60.9)	3.14	25 (95)			

*Ma e ceed 25 psi or 1.72 bar pressure drop.

		GAC/CARBON FILT	TER-AG, CALCITE			
			GREENSAND			
		BIF		IRM		
			SAND, M		IULTI-MEDIA	
Tank Dia. inches (mm)	Bed Area sq. ft.	8 gpm/sq ft (Lpm/sq ft)	10 gpm/sq ft (Lpm/sq ft)	12 gpm/sq ft (Lpm/sq ft)	15 gpm/sq ft (Lpm/sq ft)	
14 (35.6)	1.02	8 (30)	10 (38)	12 (45)	NR	
16 (40.6)	1.38	11 (42)	13 (49)	NR	NR	
18 (45.7)	1.76	*14 (53)	NR	NR	NR	
21 (53.3)	2.4	NR	NR	NR	NR	

Table 4.6 - Performa Cv Filter Sizing Selection Guide for Dual Unit Filters.

* Ma⁷ e ceed 25 psi or 1.72 bar pressure drop during back ash of second unit.

NR = Not Recommended. A flo control on the service outlet of each valve ma^{4} be required to insure proper back ash volume to back ashing unit.

:

1/

5.3 Removing the Valve Assembly for Servicing

- 1. Unplug the po er cord.
- 2. Shut off ater suppl⁷ or put b⁷ pass valve(s) into b⁷ pass position.
- 3. Remove cover and ith scre driver, relieve tank pressure b¹ pushing open valve No. 7 (rear flapper) on control as sho n (Figure 5.2).

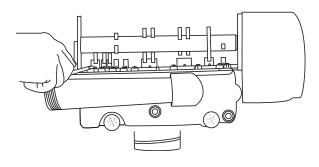


Figure 5.2

- 4. When used ith a globe valve b⁷ pass, loosen and detach the inlet, outlet, brine and drain lines from the valve. If using the 1265 b⁷ pass, loosen and remove valve from b⁷ pass as ell as loosening and removing the brine and drain lines.
- 5. Unscre (counterclock ise) and remove valve from tank.
- 6. To replace the control valve, reverse the above procedure.

5.4 Removing the Control

Complete the follo ing steps to remove the 960 ProSoft control for servicing:

- 1. Unplug the all-mount transformer.
- 2. Shut off the ater suppl⁷ or put the b⁷ pass valve(s) into b⁷ pass position.
- 3. Remove the rear cover b¹ depressing the t o tabs provided on the cover, Figure 5.3. Lift the front of the cover and remove to e pose the valve bod¹.




4. Relieve s⁷ stem pressure b⁷ opening the Back ash Drain Valve (the seventh valve back from the control) ith a scre driver, Figure 5.4.

Figure 5.4

5. To remove the camshaft or to reinstall it, the arro on the rear of the cam shaft must be pointing at the line on the year hoop of the top plate. This occurs hen the cⁱ cle indicator is rotated to the refill position. Press do n on the back of the camshaft to disengage it from the rear hoop of the top plate, Figure 5.5.


Slide the camshaft back to disengage it from the timer, Figure 5.6.

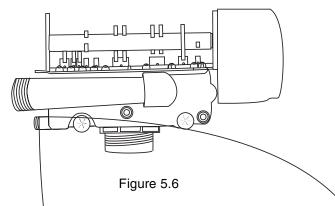


- 6. Disconnect the turbine probe from the turbine assembly.
- 7. Lift the control off the valve, Figure 5.7. To replace the control, reverse the above procedure. Note that the camshaft needs to be positioned correctl' before it can be inserted into the back of the control. There is a locating arro on the camshaft. Position the arro on the top of the shaft and slide the camshaft into the control. Push up on the end of the camshaft, furthest from the timer, snapping it into place.

Figure 5.7


5.5 Identification of Control Val




3 Brine/Slow Rinse Position

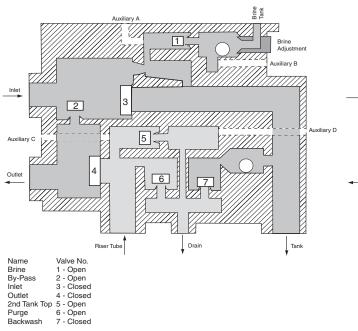

4 Fast Rinse Position

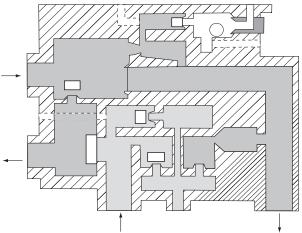


5.8 Performa Cv Filter Flow Diagrams

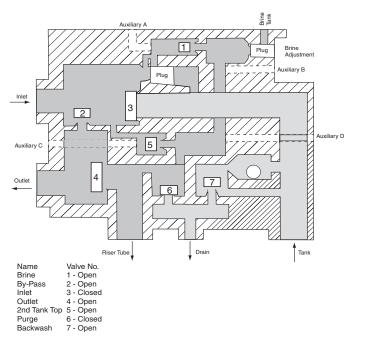

1 Backwash Position

2 Fast Rinse Position

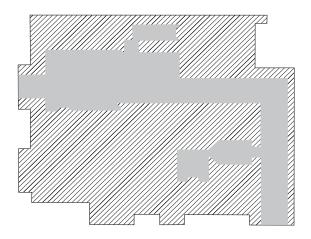

5.9 Troubleshooting

The technolog⁷ upon hich the Autotrol Performa control valve is based is ell established and proven in service over man⁷ ears. Ho ever, should a problem or question arise regarding the operation of the s⁷ stem, the control can be serviced easil⁷. For parts mentioned, refer to e ploded vie s in the **Replacement Parts** section of this manual. **IMPORTANT:** Service procedures that require the ater pressure to be removed from the s⁷ stem are marked ith a ! after the possible cause. To remove ater pressure from the s⁷ stem, put the b⁷ pass valve or three-valve b⁷ pass into the b⁷ pass position and open the back ash drain valve (the seventh valve back from the control) ith a scre driver. Restore s⁷ stem ater pressure hen the service ork is completed.

Valve Troubleshooting

1.					
	Control ill not dra brine.	a.	Lo ater pressure.	a.	Set pump to maintain 30 psi at conditioner.
		b.	Restricted drain line.	b.	Remove restriction.
		c.	Injector plugged !	с.	Clean injector and screen.
		d.	Injector defective !	d.	Replace injector.
		e.	Valve (2 and/or 4) not closed.	e.	Remove foreign matter from disc and check disc for closing b ⁷ pushing in on stem. Replace if needed.
		f.	Damaged injector O-ring.	f.	Replace, injector O-ring.
2.	Brine tank overflo .	a.	Brine valve (1) being held open.	a.	Manuall operate valve stem to flush a a bound of a bound of the stem to flush a bound of a bound of the stem a
		b.	Uncontrolled brine refill flo rate !	b.	Remove variable salt controller to clean.
		C.	Valve (3 or 4) not closed during brine dra causing refill.	C.	Flush out foreign matter b ⁷ holding disc open and manuall ⁷ operating valve stem.
	1	d.	Air leak in brine line.	d.	Check all connections in brine line for leaks. Refer to instructions.
3.	$\vec{S'}$ stem using more or less salt than salt control is set for.	a.	Inaccurate setting.	a.	Correct setting.
		b.	Foreign matter in controller causing incorrect flo rates !	b.	Remove variable salt controller and flush out foreign matter. Manuall' position control to brine dra to clean controller (after so doing, position control to purge to remove brine from tank).
		с.	Defective controller.	с.	Replace controller.
4.	Intermittent or irregular brine	a.	Lo ater pressure.	a.	Set pump to maintain 30 psi at conditioner.
	dra .	b.	Defective injector !	b.	Replace both injector and injector cap.
5.	No conditioned ater after	a.	Unit did not regenerate.	a.	Check for po er.
	regeneration.	b.	No salt in brine tank.	b.	Add salt.
		с.	Plugged injector !	с.	Clean injector. Flush ith ater.
6.	Control back ashes at e cessivel lo or high rate.	a.	Incorrect back ash controller used.	a.	Replace ith correct si e controller.
		b.	Foreign matter affecting controller operation	b.	Remove controller and ball. Flush ith ater.
	Flo ing or dripping ater at drain or brine line after regeneration.	a.	Drain valve (6 or 7) or brine valve (1) held open b ⁷ foreign matter or particle.	a.	Manuali ⁷ operate valve stem to flush a a ⁷ obstruction.
		b.	Valve stem return spring on top plate eak.	b.	Replace spring.

962 Control Troubleshooting

Alarms

The Model 962 continuousl monitors itself and sounds an alarm if it detects something rong. The alarm is a beep that is on for one second and then off for nine seconds.

When the alarm sounds, the displat sho s the letters Err ith a number from 1 to 4. The table belo lists the Err numbers, a description of each error, the cause of the error, and the solutions. To silence the alarm, press and button on the control. If the error still e ists, the control ill go back to the alarm condition after 30 seconds.

Model 960 Alarms


Indication	Description	Cause	J J Solution
Err1	Electronics Failure	Control settings need	Press an' ke' to load default values. Refer
		reprogramming.	to Programming the Model 960 Control.
Err2	Improper start of	Valve camshaft has been	Press an' ke' to sijence the alarm. (Note:
	regeneration (limit s itch	manuall [/] rotated during a	Alarm automaticall clears at TIME OF
	closed hen it should be	regeneration.	REGEN .)
	open).	Valve camshaft has been	The control ill turn the motor on and drive
		manuall [/] rotated out of	the camshaft to the proper location.
		regeneration complete	
		position.	
		Fault/ motor.	Replace the control.
		Faultų motor drive.	Replace the control.
		Fault s itch.	Replace the control.
Err3	Improper finish of	Valve camshaft has been	The control ill turn the motor on and drive
	regeneration (limit s itch	manuall [/] rotated out of	the camshaft to the proper location.
	open hen it should be	regeneration complete	
	closed).	position.	
		Fault motor.	Replace the control.
		Fault motor drive.	Replace the control.
		Fault [/] s itch.	Replace the control.
Err4	Improper control settings	One or more settings out of	Hardneşs: Adjust range: 3 to 250.
	(one or more settings out of	the allo able range.	Capacit ¹ : Adjust range: 0.1 to 140.0.
	the allo able range).		Refill control: Adjust range: 1 to 99.
			Brine dra value: Adjust range per
			Table 4.1.

Problem	Possible Cause	Solution	
1. Capacit ⁷ displa ⁷ sta ⁷ s at 9999 even through there is ater usage.	a. Total s ⁷ stem capacit ⁷ as calculated to be a value greater than 9999.	 As the _↓ ater usage continues, the remaining capacitⁱ ill drop belo 9999 and then other values ill be sho n. 	
 Timer beeps hen left arro button is pressed. 	 Button is onlⁱ active in the programming mode. 	a. Refer to the Programming section.	
3. Timer does not respond to REGEN button.	 Button is not active in the programming mode. 	a. Refer to the Regeneration section.	
4. Timer does not displai time of	a. Transformer is unplugged.	a. Connect po er.	
da⁄.	b. No electric po er at outlet.	b. Repair outlet or use orking outlet.	
	c. Defective transformer.	c. Replace transformer.	
J	d. Defective circuit board.	d. Replace control.	
5. Timer doeş not displai correct	a. Outlet operated bi a s itch.	a. Use outlet not controlled b ⁱ s itch.	
time of da [/] .	b. Po er outages.	b. Reset Time of Da ⁷ .	

	Problem		Possible Cause		Solution
6.	No ater flo displathen	a.	B ⁷ pass valve in b ⁷ pass position.	a.	Shift b ⁷ pass valve into service position.
	ater is flo ing (colon does not blink).	b.	Meter probe disconnected or not full \vec{k} connected to meter housing.	b.	Full^{7} insert probe into meter housing.
		C.	Restricted meter turbine rotation due to foreign material in meter !	C.	Remove meter housing, free up turbine and flush _j ith clean ater. Turbine should spin freel ⁷ . If not, refer to the Water Meter Maintenance section.
		d.	Defective meter probe.	d.	Replace control.
	1	e.	Defective circuit board.	e.	Replace control.
7.	Control displation is from the format	a.	Back to back regenerations ere	a.	Refer to the Manual Regeneration section.
	Regen Time Remaining.		requested.		
8.	Control regenerates at the	a.	Po er outages.	a.	Reset time of day to correct time of day.
	rong time of da ⁱ .	b.	Time of da ⁱ set incorrectl ⁱ .	b.	Reset time of da ^{i} to correct time of da ^{i} .
		С.	Time of regeneration set incorrectl ⁱ .	С.	Reset time of regeneration.
9.	Timer stalled in regeneration	a.	Motor not operating.	a.	Replace control.
	c' cle.	b.	Motor runs back ards.	b.	Replace control.
		C.	No electric po er at outlet.	с.	Repair outlet or use orking outlet.
		d.	Incorrect voltage or frequenc ⁷ (H).	d.	Replace timer and/or transformer ith one of correct voltage and frequencies (H).
		e.	Broken gear.	e.	Replace control.
		f.	Defective s itch.	f.	Replace control.
		g.	Air leak in brine connections (pressure locked flapper).	g.	Check all junction points and make appropriate corrections.
		h.	Binding of camshaft.	h.	Remove foreign object obstruction from valve discs or camshaft.
		i.	Water pressure greater than 125 psi during regeneration.	i.	Install pressure regulator to reduce pressure.
		j.	Defective circuit board.	j.	Replace control.
10.	Continuous regeneration.	a.	Broken projection on drive gear.	a.	Replace control.
	Camshaft does not stop at the end of regeneration.	b.	Defective s itch.	b.	Replace control.
11.	Control does not regenerate	a.	Transformer unplugged.	a.	Connect po er.
	automaticall [/] or hen REGEN button is depressed.	b.	No electric po er at outlet.	b.	Repair outlet or use orking outlet.
		С.	Defective motor.	С.	Replace control.
		d.	Broken gear.	d.	Replace control.
		e.	Binding in gear train.	e.	Replace control.
		f.	Defective s itch.	f.	Replace control.
12.	Control does not regenerate automaticall [/] but does regenerate hen REGEN button is depressed.	a.	If ater flo displa ^{<i>i</i>} is not operative, refer to item 5 in this table.	a.	Refer to item 5 in this table.
		b.	Incorrect hardness and capacit ⁷ settings.	b.	Set ne control values. Refer to the Programming section.
		с.	Defective circuit board.	с.	Replace control.
13.	Run out of soft ater bet een regenerations.	a.	Improper regeneration.	a.	Repeat regeneration making certain that correct salt dosage is used.
	-	b.	Fouled resin bed.	b.	Use resin cleaner.
		C.	Incorrect salt setting.	С.	Set salt control to proper level. Refer to the Programming section in this manual.
		d.	Incorrect hardness or capacit ⁷ settings.	d.	Set to correct values. Refer to the Programming section in this manual.
		e.	Water hardness has increased.	e.	Set to ne value. Refer to the Programming section in this manual.
		f.	Restricted meter turbine rotation due to foreign material in meter housing !	f.	Remove meter housing, free up turbine, and flush _j ith clean ater. Turbine should spin freel ⁱ , if not _j replace meter.
		g.	E cessive ater usage belo 1/5 gallon per minute.	g.	Repair leak ⁷ plumbing and/or fi tures.



6.3 Performa Cv Controls



>